

PG5900A Series

Industrial Protocol Gateway



PRODUCT DESCRIPTION

The PG5900A Series is a highly reliable and fault tolerant Industrial Protocol Gateway. Its powerful architecture provides seamless conversion between the different Ethernet-based protocols. The IEDs communicating on different protocols could be integrated into the system and extend its reach over the gateway's redundant Ethernet. This device is designed to work in most demanding industries such as power substations, power generation, oil and gas, farming and manufacturing.

The configuration carried out through a user friendly, Java- Based Windows Utility called eNode Designer, that allows configuring target platforms, set device properties and protocol data mapping. The configuration is completely dependent on the "eNode Module" which represents that device or application – but may include things such as changing the communication port settings and defining where data point information enters and leaves the eNode Designer system.

PG59XX Series embeds an additional layer of security, allowing the devices to be deployed in topologies that request data to flow through the Internet and preventing sensitive control and monitoring data to be readable from malicious activities. IPsec VPN encryption, configurable in both peer-to-peer and peer-to-side modes will make sure the data passing is encrypted through a strong 128, 192 or 256-bit AES encryption. OpenVPN-based applications can take advantage of Client/Server support on our device.

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131 EMAIL: sales@atop.com.tw WEB: http://www.atop.com.tw



v: 0.8




APPLICATION

Features

The protocol gateway's embedded protocol stacks allow

- Seamless conversion
- Exception/error Management
- Unsolicited event management for the protocols requiring them (such as DNP3)
- High performance
- Low cost

General Architecture

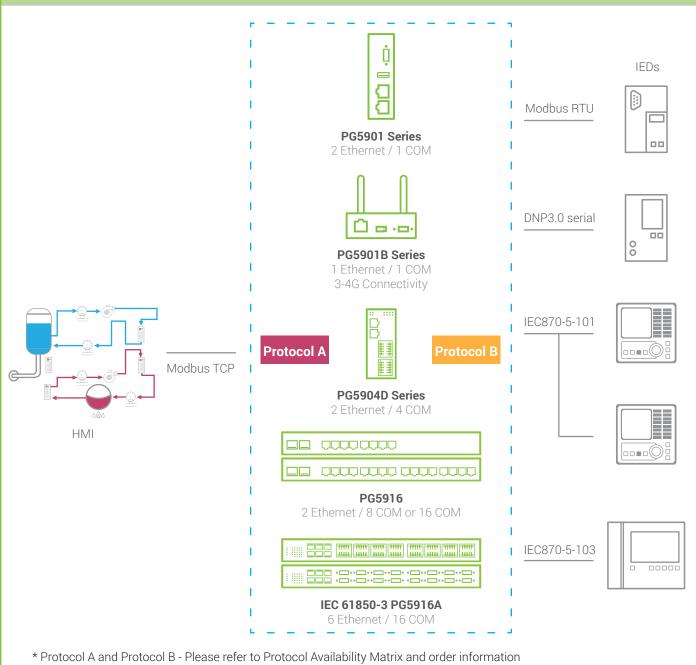

IEC 61850


CE

HC

v: 0.8

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131



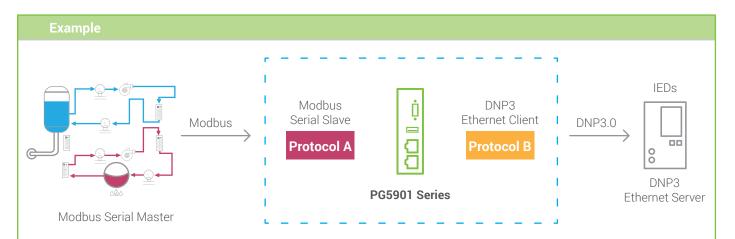

The example shows how to Easily connect a Modbus Serial HMI, through Atop's Protocol Gateway to a DNP3.0 Ethernet Server IED. The host HMI has the role of a Modbus Serial Master while the end-device to be accessed is a DNP3.0 Ethernet Server.

Atop's protocol Gateway acts towards the HMI seamlessly as a Modbus Serial Slave, answering the poll commands or the write commands required by the Host by its virtual Modbus ID. Meanwhile, it acts as a DNP3.0 Ethernet Client with regard to the end-device whose DNP3.0 address is mapped to the virtual Modbus ID that the HMI is accessing.

Be careful! – all gateway functions listed in the datasheet refer to the "Gateway" role, and not which "host" or "slave" the gate way is connected to. In this example, the SKU shown is "MBSS-DNEC" (Modbus Serial Slave to DNP3.0 Ethernet Client)

PROTOCOL AVAILABILITY

Protocol Availability Matrix for PG5900A Series					
Protocol B		Protocol A			
		Ethernet Server			
			DNP3	Modbus TCP	IEC 60870-5-104
	IEC 61850	n/a	DNES-50EC	MBES-50EC	04ES-50EC
Eth ann at Oli ant	DNP3	50ES-DNEC	n/a	MBES-DNEC	04ES-DNEC
Ethernet Client	Modbus TCP	50ES-MBEC	DNES-MBEC	n/a	04ES-MBEC
	IEC 60870-5-104	50ES-04EC	DNES-04EC	MBES-04EC	n/a

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131 EMAIL: sales@atop.com.tw WEB: http://www.atop.com.tw



v: 0.8



PROTOCOL SPECIFICATION

IEC61850 Server/ Client		
Supported Functions	 Generic access to the data(Read, Write) 8 Logical Devices per Port GOOSE (Generic Object Oriented Substation Event) – a GOOSE message will be generated by the gateway automatically upon event(*) (*)Being other protocols not Real-Time, there is no guarantee that GOOSE message is gen erated within 1 ms from the event itelf. 	
Supported Control Type of commands	 Direct-with-Normal-Security Select Before Operate (SBO)-with-Normal-Security Direct-with-Enhanced Security Select Before Operate (SBO)-with-Enhanced-Security 	
Implemented Protocol Subsets	 IEC 61850-6 (Substation Configuration Language Description: SCL) IEC 61850-7-1 (Principles and Models) IEC 61850-7-2 (Abstract Communication Service Interface: ACSI IEC 61850-7-3 (Common Data Classes: CDC) IEC 61850-7-4 (Logical Nodes and data Object Classes) IEC 61850-8-1 (Mapping to Manufacturing Message Specification: MMS) Edition 1 & Edition 2 are both Supported 	

DNP3 Server / Client	
 Serial Mode or Ethernet with TCP or UDP Mode Server side supports serving up to 5 client in TCP Mode Client side in a single RS-485 port, supports connecting up to 16 IEDs Client side supports connecting up to 16 IEDs Maximum Fragment size 2048 octets Protocol implementation with configurable parameters conforms to IEEE Std level 2 	
Supported Functions	 Time Synchronization generic access to the data(Read, Write) Commands with or without preselection (Select, Operate, Direct Operate) Transmission of time-tagged events Counter management (Immediate Freeze, Freeze and Clear) Self-address
Supported DNP3 Object Library	 Binary Inputs up to 8000 pts Binary Outputs up to 2000 pts Double Inputs up to 4000 pts Analog Inputs up to 250 pts Analog Outputs up to 250 pts Counters up to 250 pts

Modbus Server / Client		
General Specifications	 Support Modbus in TCP mode For Modbus Client in TCP mode, support connecting up to 64 Modbus servers For Modbus Server in TCP mode, support serving up to 64 Modbus clients Support maximum number of data points in read direction: 8000 pts Support maximum number of commands in write direction: 4000 pts 	

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131





Supported Function Codes	1: Read Coils 2: Read Discrete Inputs 3: Read Holding Registers 4: Read Input Registers 5: Write Single Coil 6: Write Single Register 15: Write Multiple Coils 16: Write Multiple Registers 43/14: Read Device Identification (server side only)	
Supported Exception Codes	1: illegal function 2: illegal data address 3: illegal data value 4: server device failure 6: server device busy	

IEC 60870-5-104 Server/ Client			
General Specifications	 Server side supports serving up to 5 client Client side supports connecting up to 10 IEDs Protocol implementation with configurable parameters conforms to the IEC 60870-5-1 specification edition 2 Process Information in Monitor and Control Direction CP56Time2a timestamp for Control Commands 		
Supported Functions	 Station Initialization Interrogation Read Procedure (Server side only) Cyclic Data and Spontaneous Transmission (Server side only) Clock Synchronization Transmission of Integrated Totals Direct and SBO command 		
Supported Data Types	 Monitors Points: Each supports maximum 1000 pts: Single Point, Double Point, Step Position, Bit String, sured with Normalized Value, Measured with Scaled Value, Measured Short Floating Po Value, Integrated Totals. Control Points: Each supports maximum 500 pts: Single Command, Double Command, Regulating Step Command, Set Point Command with Normalized Value, Set Point Command with Scale Value, Set Point Command Short Floating Point, Bitstring. Event Logging (Server Side only) Universal Event Buffer up to 20,000 Events 		

Hardware Specifications

Network Interface	
Ethernet Port	6 x RJ-45 or 6 x SFP slot
LAN Mode	Dual Subnets or RSTP Redundancy
Compliance	IEEE 802.3 10BASE-T IEEE 802.3u 100BASE-T(X) and 100BASE-FX

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131





Connector	10-Pin Terminal Block		
Input Voltage	24-48 VDC 100-240 VAC/ 100-370 VDC for HV Series		
Power Consumption	0.73A @ 24 VDC 0.35A @ 100 VAC 0.2A @ 100 VDC		
Power Redundancy	Yes (Two Modules)		
Reverse Polarity Protection	Yes		
Mechanicals			
Housing	IP30 protection, metal housing		
Dimensions(W x H x D)	440.6mm x 44mm x 309mm		
Installation	19" Rack Mount		
Reset Button	Yes		
Weight	4kg		
Environmental Limits			
Operating Temperature	-40°C ~ 85°C (-40°F ~ 185°F)		
Storage Temperature	-40°C ~ 85°C (-40°F ~ 185°F)		
Ambient Relative Humidity	5 ~ 95% RH, (non-condensing)		
Software			
Protocols	IPv4, ARP, ICMP, TCP, UDP, DHCP Client, DNS Client, Telnet, HTTP, HTTPS, SMTP/TLS, SNMP v1/v2c/v3, Syslog, 802.1D-2004 RSTP, OpenVPN Client/Server, IPsec VPN pee peer and peer-to-side, maximum VPN throughput of 37.9Mbps(*), and PPTP		

* testing conditions may affect the VPN throughput

REGULATORY APPROVALS

Safety	EN 61010-1, EN 61010-2-201		
EMC	FCC Part 15, Subpart B, Class A EN 55032, Class A EN 61000-6-2, Class A EN 61000-3-2 EN 61000-3-3 EN 55024 EN 61000-6-4 IEC 61850-3 / IEEE 1613		

TEL: + 886 - 3 - 5508137 FAX: + 886 - 3 - 5508131 EMAIL: sales@atop.com.tw WEB: http://www.atop.com.tw



v: 0.8



Test	lt	em	Value	Level
IEC 61000-4-2	ESD	Contact Discharge Air Discharge	±8KV ±15KV	4
IEC 61000-4-3	RS	Enclosure	10 V/m	3
IEC 61000-4-4	EFT	AC Power Port DC Power Port Signal Port	±4.0KV ±4.0KV ±4.0KV	4 4 4
IEC 61000-4-5	Surge	AC Power Port AC Power Port DC Power Port DC Power Port Signal Port Signal Port	Line-to Line±2.0KV Line-to Earth±4.0KV Line-to Line±1.0KV Line-to Earth±2.0KV Line-to Line±2.0KV Line-to Earth±4.0KV	4 3 3 4 4
IEC 61000-4-6	CS	AC Power Port DC Power Port Signal Port	10 Vrms 10 Vrms 10 Vrms	3 3 3
IEC 61000-4-8	PFMF	Enclosure	100A/m	5
IEC 61000-4-11	DIP	AC Power Port	-	-
Shock	MIL-STD-810F Met	hod 516.5		
Drop	MIL-STD-810F Method 516.5			
Vibration	MIL-STD-810F Method 514.5 C-1 & C-2			
RoHS	Yes			
REACH	Yes			
MTBF	16.60			
Warranty	5 years			

ORDERING INFORMATION

Hardware	
PG5900A-6SFP	Industrial Protocol Gateway,10/100BASE-T(X) SFP slot, 24-48 VDC
PG5900A-6SFP-HV	Industrial Protocol Gateway,10/100BASE-T(X) SFP slot, 100-240VAC/ 100-370VDC
PG5900A	Industrial Protocol Gateway,10/100BASE-T(X) RJ45, 24-48 VDC
PG5900A-HV	Industrial Protocol Gateway,10/100BASE-T(X) RJ45, 100-240VAC/ 100-370VDC

Optional Accessories		
Model Name	Part Number	Description
SDR-75-24	50500752240001G	75W/3.2A DIN-Rail 24VDC power supply with universal 88-264VAC / 124- 370VDC input
GDC-120	59906861G	120mm copper woven grounding cable
ADP-DB9(F)TB5	59906231G	Female DB9 to Female 3.81mm TB5 Converter
AXFD-1314-0523	522AXFD1314001G	SFP Transceiver;155Mbps, Multi-mode;1310nm;2km;-40~85, DDMI
AXFD-1314-0553	522AXFD1314011G	SFP Transceiver;155Mbps, Single-mode;1310nm;30km;-40~85, DDMI

v: 0.8



Protocols	
SKU	Description
04ES-50EC	IEC 60870-5-104 Ethernet Server to IEC 61850 Ethernet Client
04ES-DNEC	IEC 60870-5-104 Ethernet Server to DNP3 Ethernet Client
04ES-MBEC	IEC 60870-5-104 Ethernet Server to Modbus Ethernet Client
50ES-04EC	IEC 61850 Ethernet Server to IEC 60870-5-104 Ethernet Client
50ES-DNEC	IEC 61850 Ethernet Server to DNP3 Ethernet Client
50ES-MBEC	IEC 61850 Ethernet Server to Modbus Ethernet Client
DNES-04EC	DNP3 Ethernet Server to IEC 60870-5-104 Ethernet Client
DNES-50EC	DNP3 Ethernet Server to IEC 61850 Ethernet Client
DNES-MBEC	DNP3 Ethernet Server to Modbus Ethernet Client
MBES-04EC	Modbus Ethernet Server to IEC 60870-5-104 Ethernet Client
MBES-50EC	Modbus Ethernet Server to IEC 61850 Ethernet Client
MBES-DNEC	Modbus Ethernet Server to DNP3 Ethernet Client



