

## Industrial Protocol Gateway

### PG5908A/PG5916A Series



#### Feature Highlights

- ✓ Compliant with IEC 61850-3 and IEEE 1613 Power Substation Standards
- ✓ 8 or 16-port RS-232/422/485, baud rate up to 921.6 Kbps
- ✓ Isolated redundant power inputs with 24-48 VDC ,100-240 VAC, 100-370 VDC variations
- ✓ Works in environments from -40 to 85°C
- ✓ Same hardware platform for different protocol conversion (Modbus TCP/RTU/ASCII, DNP3.0 TCP or serial, IEC 60870-5-101, IEC 60870-5-103, IEC 60870-5-104, IEC 61850)
- ✓ User friendly configuration with a Java-Based Windows utility
- ✓ Embedded PPTP, IPsec and OpenVPN Client/Server for enhanced security

#### Product Description

The PG59XX Series is a highly reliable and fault tolerant Industrial Protocol Gateway. Its powerful architecture provides seamless conversion between the different protocols Ethernet or Serial based. The serial devices communicating on different protocols could be integrated into the system and extend its reach over the gateway's redundant Ethernet that can be set up as dual-subnet or RSTP redundancy. This device is designed to work in most demanding industries such as power substations, power generation, oil and gas, farming and manufacturing.

The configuration carried out through a use friendly, Java- Based Windows Utility called eNode Designer, that allows configuring target platforms, set device properties and protocol data mapping. The configuration is completely dependent on the "eNode Module" which represents that device or application – but may include things such as changing the communication port settings and defining where data point information enters and leaves the eNode Designer system.

PG59XX Series embeds an additional layer of security, allowing the devices to be deployed in topologies that request data to flow through the Internet and preventing sensitive control and monitoring data to be readable from malicious activities. IPsec VPN encryption, configurable in both peer-to-peer and peer-to-side modes will make sure the data passing is encrypted through a strong 128, 192 or 256-bit AES encryption. OpenVPN-based applications can take advantage of Client/Server support on our device.

Atop Technologies, Inc.  
TEL: +886-3-5508137 FAX: +886-3-5508131  
sales@atop.com.tw  
<http://www.atop.com.tw>



Design and specification are subjected to change without notice.

All product names referenced herein are registered trademarks of their respective companies.

V0.9


## Application

### Features

The protocol gateway's embedded protocol stacks allow

- Seamless conversion
- Exception/error Management
- Unsolicited event management for the protocols requiring them (such as DNP3)
- High performance
- Low cost

### General Architecture

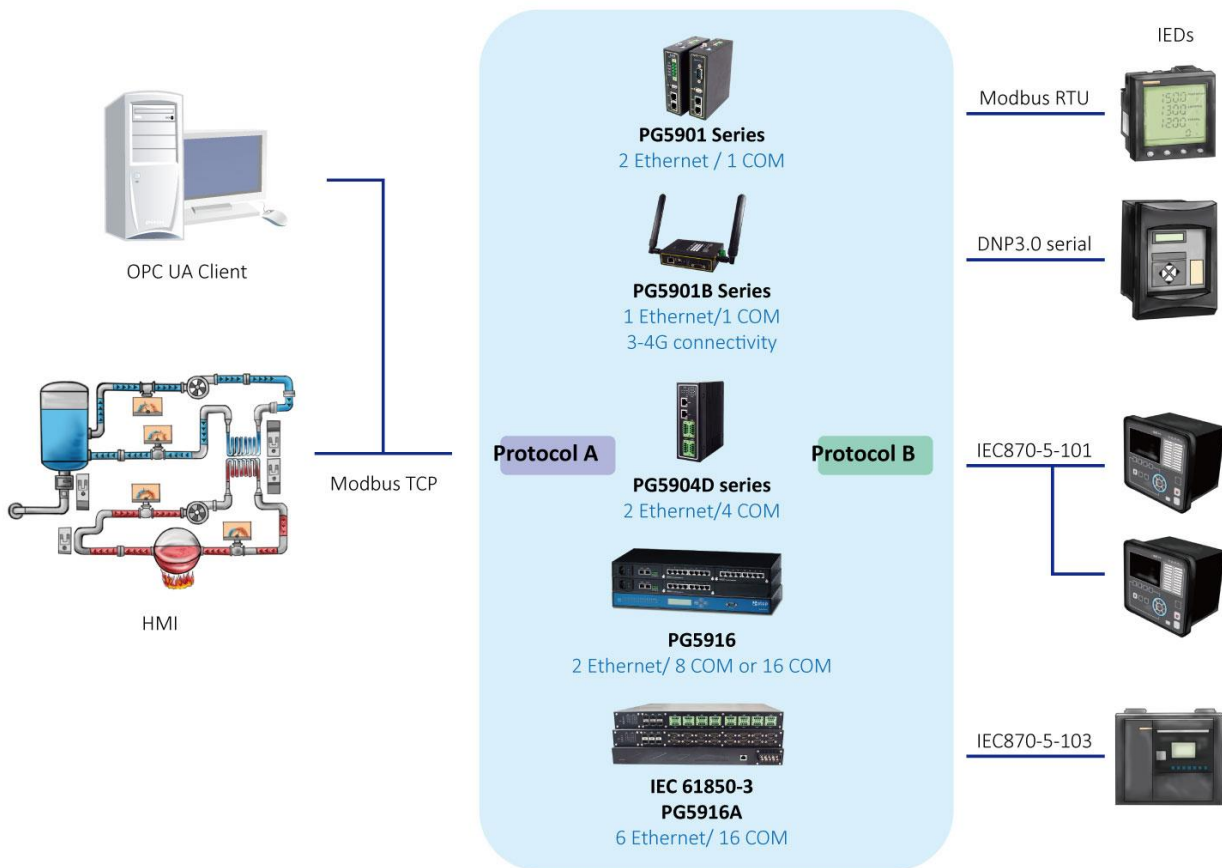

\* Protocol A and Protocol B - Please refer to Protocol Availability Matrix and order information

### Example



The example shows how to Easily connect a Modbus Serial HMI, through Atop’s Protocol Gateway to a DNP3.0 Ethernet slave IED. The host HMI has the role of a Modbus Serial Master while the end-device to be accessed is a DNP3.0 Ethernet Server.

Atop’s protocol Gateway acts towards the HMI seamlessly as a Modbus Serial Slave, answering the poll commands or the write commands required by the Host by its virtual Modbus ID. Meanwhile, it acts as a DNP3.0 Ethernet Client with regard to the end-device whose DNP3.0 address is mapped to the virtual Modbus ID that the HMI is accessing.

**Be careful!** – all gateway functions listed in the datasheet refer to the “Gateway” role, and not which “host” or “slave” the gateway is connected to. In this example, the SKU shown is “MBSS-DNEC” (Modbus Serial Slave to DNP3.0 Ethernet Client)

### Protocol Availability Matrix for PG5908A/PG5916A Series

Protocol B		Protocol A							
		Ethernet Server				Serial Slave			
		IEC 61850	DNP3	Modbus TCP	IEC 60870-5-104	DNP3	Modbus RTU/ASCII	IEC 60870-5-101	IEC 60870-5-103
Ethernet Client	IEC 61850	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
	DNP3	n/a	n/a	n/a	n/a	DNSS-DNEC	MBSS-DNEC	n/a	n/a
	Modbus TCP	n/a	n/a	n/a	n/a	DNSS-MBEC	n/a	n/a	n/a
	IEC 60870-5-104	n/a	n/a	n/a	n/a	n/a	MBSS-04EC	n/a	n/a
Serial Master	DNP3	50ES-DNSM	DNES-DNSM	MBES-DNSM	04ES-DNSM	DNSS-DNSM	MBSS-DNSM	01SS-DNSM	03SS-DNSM
	Modbus RTU/ASCII	50ES-MBSM	DNES-MBSM	n/a	04ES-MBSM	DNSS-MBSM	n/a	01SS-MBSM	03SS-MBSM
	IEC 60870-5-101	50ES-01SM	DNES-01SM	MBES-01SM	04ES-01SM	DNSS-01SM	MBSS-01SM	n/a	03SS-01SM
	IEC 60870-5-103	50ES-03SM	DNES-03SM	MBES-03SM	04ES-03SM	DNSS-03SM	MBSS-03SM	01SS-03SM	n/a

Protocol Specifications			
IEC61850 Server/ Client		DNP3 Server/ Client/ Master/ Slave	
Supported Functions	<ul style="list-style-type: none"> <li>• Generic access to the data (Read, Write)</li> <li>• Clock Synchronization</li> <li>• 8 Logical Devices per Port</li> <li>• GOOSE (Generic Object Oriented Substation Event) – a GOOSE message will be generated by the gateway automatically upon event(*)</li> </ul> <p>(*)Being other protocols not Real-Time, there is no guarantee that GOOSE message is generated within 1 ms from the event itself.</p>	General Specifications	<ul style="list-style-type: none"> <li>• Serial Mode or Ethernet with TCP or UDP Mode</li> <li>• Server side supports serving up to 5 client in TCP Mode</li> <li>• Client side in a single RS-485 port, supports connecting up to 16 IEDs</li> <li>• Client side supports connecting up to 16 IEDs</li> <li>• Maximum Fragment size 2048 octets</li> <li>• Protocol implementation with configurable parameters conforms to IEEE Std 1815-2012 level 2</li> </ul>
Supported Control Type of commands	<ul style="list-style-type: none"> <li>• Direct-with-Normal-Security Select Before Operate (SBO)-with-Normal-Security</li> <li>• Direct-with-Enhanced Security Select Before Operate (SBO)-with-Enhanced-Security</li> </ul>	Supported Functions	<ul style="list-style-type: none"> <li>• Time Synchronization generic access to the data(Read, Write)</li> <li>• Commands with or without preselection (Select, Operate, Direct Operate)</li> <li>• Transmission of time-tagged events</li> <li>• Counter management (Immediate Freeze, Freeze and Clear)</li> <li>• Self-address</li> </ul>
Implemented Protocol Subsets	<ul style="list-style-type: none"> <li>• IEC 61850-6 (Substation Configuration Language Description: SCL)</li> <li>• IEC 61850-7-1 (Principles and Models)</li> <li>• IEC 61850-7-2 (Abstract Communication Service)</li> <li>• Interface: ACSI</li> <li>• IEC 61850-7-3 (Common Data Classes: CDC)</li> <li>• IEC 61850-7-4 (Logical Nodes and data Object Classes)</li> <li>• IEC 61850-8-1 (Mapping to Manufacturing Message Specification: MMS)</li> <li>• Edition 1 &amp; Edition 2 are both Supported</li> </ul>	Supported DNP3 Object Library	<ul style="list-style-type: none"> <li>• Binary Inputs up to 8000 pts</li> <li>• Binary Outputs up to 2000 pts</li> <li>• Double Inputs up to 4000 pts</li> <li>• Analog Inputs up to 250 pts</li> <li>• Analog Outputs up to 250 pts</li> <li>• Counters up to 250 pts</li> </ul>

Modbus Server/ Client/ Master/ Slave		IEC 60870-5-101 Master/ Slave	
General Specifications	<ul style="list-style-type: none"> <li>• Support Modbus RTU and ASCII in Serial mode</li> <li>• Support Modbus in TCP mode</li> <li>• For Modbus Client in TCP mode, support connecting up to 64 Modbus servers</li> <li>• For Modbus Server in TCP mode, support serving up to 64 Modbus clients</li> <li>• Support maximum number of data points in read direction: 8000 pts</li> <li>• Support maximum number of commands in write direction: 4000 pts</li> </ul>	General Specifications	<ul style="list-style-type: none"> <li>• Protocol implementation with configurable parameters conforms to the IEC 60870-5-101 edition 2 specification</li> <li>• Process Information in Monitor and Control Direction</li> <li>• Balanced and Unbalanced Modes</li> <li>• CP24Time2a or CP56Time2a timestamp for monitor direction report</li> </ul>
Supported Function Codes	1: Read Coils 2: Read Discrete Inputs 3: Read Holding Registers 4: Read Input Registers 5: Write Single Coil 6: Write Single Register 15: Write Multiple Coils 16: Write Multiple Registers 43/14: Read Device Identification (server side only)	Supported Functions	<ul style="list-style-type: none"> <li>• Station Initialization</li> <li>• Interrogation</li> <li>• Read Procedure</li> <li>• Cyclic Data and Spontaneous Transmission (Slave Side only)</li> <li>• Clock Synchronization</li> <li>• Transmission of Integrated Totals</li> <li>• Direct and SBO command</li> </ul>
Supported Exception Codes	1: illegal function 2: illegal data address 3: illegal data value 4: server device failure 6: server device busy	Supported Data Types	<ul style="list-style-type: none"> <li>• Monitors Points: Each supports up to 1000 pts: Single Point, Double Point, Step Position, Bit String, Measured with Normalized Value, Measured with Scaled Value, Measured Short Floating Point Value, Integrated Totals</li> <li>• Control Points: Each supports up to 500 pts: Single Command, Double Command, Regulating Step Command, Set Point Command with Normalized Value, Set Point Command with Scaled Value, Set Point Command Short Floating Point, Bit string</li> </ul>

IEC 60870-5-103 Master/ Slave		IEC 60870-5-104 Server/ Client	
General Specifications	<ul style="list-style-type: none"> <li>• Protocol implementation with configurable parameters conforms to the IEC 60870-5-103:1997</li> <li>• Master supports connecting up to 16 IEDs</li> <li>• Process Information in Monitor and Control Direction</li> <li>• Unbalanced Modes</li> </ul>	General Specifications	<ul style="list-style-type: none"> <li>• Server side supports serving up to 5 client</li> <li>• Client side supports connecting up to 10 IEDs</li> <li>• Protocol implementation with configurable parameters conforms to the IEC 60870-5-104 specification edition 2</li> <li>• Process Information in Monitor and Control Direction</li> <li>• CP56Time2a timestamp for Control Commands</li> </ul>
Supported Functions	<ul style="list-style-type: none"> <li>• Station Initialization, Supports reset FCB and CU</li> <li>• General Interrogation</li> <li>• Clock Synchronization</li> <li>• Command Transmission</li> <li>• Test Mode</li> <li>• Blocking of Monitor Direction</li> </ul>	Supported Functions	<ul style="list-style-type: none"> <li>• Station Initialization</li> <li>• Interrogation</li> <li>• Read Procedure (Server side only)</li> <li>• Cyclic Data and Spontaneous Transmission (Server side only)</li> <li>• Clock Synchronization</li> <li>• Transmission of Integrated Totals</li> <li>• Direct and SBO command</li> </ul>
Supported Information	<ul style="list-style-type: none"> <li>• Monitor direction: <ul style="list-style-type: none"> <li>* Status indications in monitor direction: from &lt;16&gt; to &lt;30&gt;</li> <li>* Supervision indications in monitor direction: &lt;32&gt;, &lt;33&gt;, from &lt;35&gt; to &lt;39&gt;, &lt;46&gt;, &lt;47&gt;</li> <li>* Earth fault indications in monitor direction: from &lt;48&gt; to &lt;52&gt;</li> <li>* Fault indications in monitor direction: from &lt;64&gt; to &lt;93&gt;</li> <li>* Auto-reclosure indications in monitor direction: from &lt;128&gt; to &lt;130&gt;</li> <li>* Measurands in monitor direction: from &lt;144&gt; to &lt;148&gt;</li> </ul> </li> <li>• Control direction: <ul style="list-style-type: none"> <li>General commands in control direction: from &lt;16&gt; to &lt;19&gt;, from &lt;23&gt; to &lt;26&gt;</li> </ul> </li> </ul>	Supported Data Types	<ul style="list-style-type: none"> <li>• Monitors Points: <ul style="list-style-type: none"> <li>Each supports maximum 1000 pts: Single Point, Double Point, Step Position, Bit String, Measured with Normalized Value, Measured with Scaled Value, Measured Short Floating Points Value, Integrated Totals.</li> </ul> </li> <li>• Control Points: <ul style="list-style-type: none"> <li>Each supports maximum 500 pts: Single Command, Double Command, Regulating Step Command, Set Point Command with Normalized Value, Set Point Command with Scaled Value, Set Point Command Short Floating Point, Bitstring.</li> </ul> </li> <li>• Event Logging (Server Side only) <ul style="list-style-type: none"> <li>Universal Event Buffer up to 20,000 Events</li> </ul> </li> </ul>



Hardware Specifications	
<b>Network Interface</b>	
Ethernet Port	6 x RJ-45 or 6 x SFP slot
LAN Mode	Dual Subnets or RSTP Redundancy
Compliance	IEEE 802.3 10BASE-T IEEE 802.3u 100BASE-T(X) and 100BASE-FX
<b>Serial Interface</b>	
Connector	5-Pin 5.08mm Terminal Block or D-Sub9 connector
Port	8 or 16
Mode	RS-232/422/485, software selectable
Baud Rate	1,200~921,600 bps
Parity	None, Odd, Even, Space, Mark
Data Bits	5,6,7,8
Stop Bits	1,2
Flow Control	None, Xon/Xoff, RTS/CTS (RS-232 only)
<b>Power Characteristics</b>	
Connector	10-Pin Terminal Block
Input Voltage	24-48 VDC 100-240 VAC/ 100-370 VDC for HV Series
Power Consumption	0.73A @ 24 VDC 0.35A @ 100 VAC 0.2A @ 100 VDC
Power Redundancy	Yes (Two Modules)
Reverse Polarity Protection	Yes
<b>Mechanicals</b>	
Housing	IP30 protection, metal housing
Dimensions(W x H x D)	440.6mm x 44mm x 309mm
Installation	19" Rack Mount
Reset Button	Yes
Weight	4kg
<b>Environmental Limits</b>	
Operating Temperature	-40°C ~ 85°C (-40°F ~ 185°F)
Storage Temperature	-40°C ~ 85°C (-40°F ~ 185°F)
Ambient Relative Humidity	5 ~ 95% RH, (non-condensing)
<b>Software</b>	
Protocols	IPv4, ARP, ICMP, TCP, UDP, DHCP Client, DNS Client, Telnet, HTTP, HTTPS, , SMTP/TLS, SNMP v1/v2c/v3, Syslog, 802.1D-2004 RSTP, OpenVPN client/server, IPsec VPN peer-to-peer and peer-to-side, maximum VPN throughput of 37.9Mbps(*), and PPTP

\* testing conditions may affect the VPN throughput

Regulatory Approvals				
Safety	EN 61010-2-201			
EMC	FCC Part 15, Subpart B, Class B EN 55032, Class B EN 61000-6-2, Class B EN 61000-3-2 EN 61000-3-3 EN 55024 EN 61000-6-4 IEC 61850-3 / IEEE 1613			
Test	Item		Value	Level
IEC 61000-4-2	ESD	Contact Discharge	±8KV	4
		Air Discharge	±15KV	4
IEC 61000-4-3	RS	Enclosure	10 V/m	3
IEC 61000-4-4	EFT	AC Power Port	±4.0KV	4
		DC Power Port	±4.0KV	4
		Signal Port	±4.0KV	4
IEC 61000-4-5	Surge	AC Power Port	Line-to Line±2.0KV	4
		AC Power Port	Line-to Earth±4.0KV	4
		DC Power Port	Line-to Line±1.0KV	3
		DC Power Port	Line-to Earth±2.0KV	3
		Signal Port	Line-to Line±2.0KV	4
IEC 61000-4-6	CS	AC Power Port	10 Vrms	3
		DC Power Port	10 Vrms	3
		Signal Port	10 Vrms	3
IEC 61000-4-8	PFMF	Enclosure	100A/m	5
IEC 61000-4-10	Damped Oscillatory Magnetic Field	Enclosure	100A/m	5
IEC 61000-4-11	DIP	AC Power Port	-	-
IEC 61000-4-12	Damped Oscillatory	AC Power Port	2.5 KV common, 1 KV differential	3
		Signal Port	2.5 KV common, 1 KV differential	3
Shock	MIL-STD-810F Method 516.5			
Drop	MIL-STD-810F Method 516.5			
Vibration	MIL-STD-810F Method 514.5 C-1 & C-2			
RoHS	Yes			
MTBF	PG5916A-6SFP-Sis-HV: 9.18 years; PG5916A-6SFP-Sis: 8.63 years			
Warranty	5 years			



## Ordering Information

### Hardware

PG5916A-6SFP	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, DB9, 24-48 VDC
PG5916A-6SFP-TB	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, TB5, 24-48 VDC
PG5916A-6SFP-Sis	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, Isolation, 24-48 VDC
PG5908A-6SFP	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, DB9, 24-48 VDC
PG5908A-6SFP-TB	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, TB5, 24-48 VDC
PG5908A-6SFP-Sis	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, Isolation, 24-48 VDC
PG5916A-6SFP-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP, DB9, 100-240VAC/100-370VDC
PG5916A-6SFP-TB-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, TB5, 100-240VAC/100-370VDC
PG5916A-6SFP-Sis-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) SFP, Isolated, 100-240VAC/100-370VDC
PG5908A-6SFP-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, DB9, 100-240VAC/ 100-370VDC
PG5908A-6SFP-TB-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP slot, TB5, 100-240VAC/ 100-370VDC
PG5908A-6SFP-Sis-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) SFP, Isolated, 100-240VAC/ 100-370VDC
PG5916A	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, DB9, 24-48 VDC
PG5916A-TB	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, TB5, 24-48 VDC
PG5916A-Sis	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, Isolation, 24-48 VDC
PG5908A	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, DB9, 24-48 VDC
PG5908A-TB	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, TB5, 24-48 VDC
PG5908A-8P-Sis	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, Isolation, 24-48 VDC
PG5916A-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, DB9, 100-240VAC/ 100-370VDC
PG 5916A-TB-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, TB5, 100-240VAC/ 100-370VDC
PG 5916A-Sis-HV	Ind. 16 Port Protocol Gateway, 10/100BASE-T(X) RJ45, Isolated,100-240VAC/100-370VDC
PG 5908A-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, DB9, 100-240VAC/ 100-370VDC
PG 5908A-TB-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, TB5, 100-240VAC/ 100-370VDC
PG 5908A-Sis-HV	Ind. 8 Port Protocol Gateway, 10/100BASE-T(X) RJ45, Isolation, 100-240VAC/100-370VDC

### Optional Accessories

Model Name	Part Number	Description
SDR-75-24	50500752240001G	75W/3.2A DIN-Rail 24VDC power supply 88~264VAC / 124-370VDC input
GDC-120	59906861G	120mm copper woven grounding cable
ADP-DB9(F)-TB5	59906231G	Female DB9 to Female 3.81mm TB5 Converter
LM38-A3S-TI-N	50708051G	SFP Transceiver, 155Mbps, 1310nmLED, Multi-mode, 2km, 3.3V, -40~85C
LS38-A3S-TI-N	50709431G	SFP Transceiver, 155Mbps, 1310nmFP, Single-mode, 30km, 3.3V, -40~85C

### Protocols

04ES-01SM	IEC 60870-5-104 Ethernet Server to IEC 60870-5-101 Serial Master
04ES-DNSM	IEC 60870-5-104 Ethernet Server to DNP3 Serial Master
04ES-MBSM	IEC 60870-5-104 Ethernet Server to Modbus Serial Master
DNES-01SM	DNP3 Ethernet Server to IEC 60870-5-101 Serial Master
DNES-DNSM	DNP3 Ethernet Server to DNP3 Serial Master
DNES-MBSM	DNP3 Ethernet Server to Modbus Serial Master

Atop Technologies, Inc.  
 TEL: +886-3-5508137 FAX: +886-3-5508131  
 sales@atop.com.tw  
 http://www.atop.com.tw



Design and specification are subjected to change without notice.

All product names referenced herein are registered trademarks of their respective companies.

V0.9

DNSS-DNEC	DNP3 Serial Slave to DNP3 Ethernet Client
DNSS-MBEC	DNP3 Serial Slave to Modbus Ethernet Client
MBES-01SM	Modbus Ethernet Server to IEC 60870-5-101 Serial Master
MBES-DNSM	Modbus Ethernet Server to DNP3 Serial Master
MBSS-04EC	Modbus Serial Slave to IEC 60870-5-104 Ethernet Client
MBSS-DNEC	Modbus Serial Slave to DNP3 Ethernet Client
01SS-DNSM	IEC 60870-5-101 Serial Slave to DNP3 Serial Master
01SS-MBSM	IEC 60870-5-101 Serial Slave to Modbus Serial Master
DNSS-01SM	DNP3 Serial Slave to IEC 60870-5-101 Serial Master
DNSS-DNSM	DNP3 Serial Slave to DNP3 Serial Master
DNSS-MBSM	DNP3 Serial Slave to Modbus Serial Master
MBSS-01SM	Modbus Serial Slave to IEC 60870-5-101 Serial Master
MBSS-DNSM	Modbus Serial Slave to DNP3 Serial Master
04ES-03SM	IEC 60870-5-104 Ethernet Server to IEC 60870-5-103 Serial Master
50ES-01SM	IEC 61850 Ethernet Server to IEC 60870-5-101 Serial Master
50ES-03SM	IEC 61850 Ethernet Server to IEC 60870-5-103 Serial Master
50ES-DNSM	IEC 61850 Ethernet Server to DNP3 Serial Master
50ES-MBSM	IEC 61850 Ethernet Server to Modbus Serial Master
DNES-03SM	DNP3 Ethernet Server to IEC 60870-5-103 Serial Master
MBES-03SM	Modbus Ethernet Server to IEC 60870-5-103 Serial Master
01SS-03SM	IEC 60870-5-101 Serial Slave to IEC 60870-5-103 Serial Master
03SS-01SM	IEC 60870-5-103 Serial Slave to IEC 60870-5-101 Serial Master
03SS-DNSM	IEC 60870-5-103 Serial Slave to DNP3 Serial Master
03SS-MBSM	IEC 60870-5-103 Serial Slave to Modbus Serial Master
DNSS-03SM	DNP3 Serial Slave to IEC 60870-5-103 Serial Master
MBSS-03SM	Modbus Serial Slave to IEC 60870-5-103 Serial Master